

# Active Ventilation Products Inc.

## TEST REPORT

### SCOPE OF WORK

This report gives the results of air leakage and flow rate testing on a vent. The sample was selected and supplied by the client and was received at the laboratories on:

July 16, 2024

The sample appeared to be in new unused condition upon receipt.

### MODEL NUMBER

KV-5-TP

Keepa Vent, 5" Diameter, 11" Collar & Tail Pipe

Roof Jack Vent Cap for Flat Roofs & Exhaust Duct Applications

### PROJECT NUMBER

G105373958

### REPORT NUMBER

105373958CRT-003b

### ISSUE DATE

July 29, 2024

### REVISED DATE

10/1/2024

### TEST DATE

July 16 - 24, 2024

### DOCUMENT CONTROL NUMBER

DIFF.PKT.2022

© 2022 INTERTEK

  
Total Quality. Assured.

**REPORT NUMBER**  
105373958CRT-003b

**MODEL NUMBER(s)**  
KV-5-TP, Keepa Vent, 5" Diameter, 11" Collar & Tail Pipe

**REPORT RENDERED TO:**  
Active Ventilation Products Inc.  
311 1st  
Newburgh, NY 12550

**AUTHORIZATION**

The testing performed was authorized by signed quote number Qu-0133691-6.

**TEST STANDARDS**

ANSI/AMCA Standard 500-L-23, entitled "Laboratory Methods of Testing Louvers for Rating".

In Charge of Testing:



Joey Esce  
Project Engineer  
Acoustical Testing

Reviewer:



Brian Cyr  
Engineer  
Acoustical Testing

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

**SAMPLE INFORMATION**

**REPORT NO. 105373958CRT-003B**

**ITEMS RECEIVED**

Item No.	Control No.	Model No.	Description	Received
1	CRT2407161018-003	KV-5-TP	Keepa Vent, 5" Diameter	July 16, 2024

**DESCRIPTION OF TEST SPECIMEN**

The sample consisted of an exhaust vent cap. The inlet measured 4-3/4 inches in diameter and the vent cap measured 8-1/4 inches in diameter. The gap between the cap and collar was measured to be 1-1/4 inch.

**SAMPLE PHOTOS**



**TEST METHODS**

Air Performance testing was conducted in accordance with ANSI/AMCA Standard 500-L-23, entitled "Laboratory Methods of Testing Louvers for Rating"

Air Volume was measured employing metering stations containing appropriately sized orifice plates.

**RESULTS OF TESTS**

**REPORT NO. 105373958CRT-003B**


**AIR PERFORMANCE**  
**KV-5-TP, Keepa Vent, 5" Diameter, 11" Collar & Tail Pipe**

Pressure Drop Across Vent Cap		Air Velocity	Airflow Volume
<u>in. H<sub>2</sub>O</u>	<u>Pa</u>	<u>fpm</u>	<u>SCFM</u>
0.020	5	404	55
0.050	12	603	82
0.095	24	801	109
0.140	35	1007	137
0.210	52	1213	165
0.270	67	1397	190
0.360	90	1603	218
0.440	109	1787	243
0.540	134	2007	273
0.650	162	2213	301

fpm = feet per minute

in. H<sub>2</sub>O = inches of water

scfm = standard cubic feet per minute

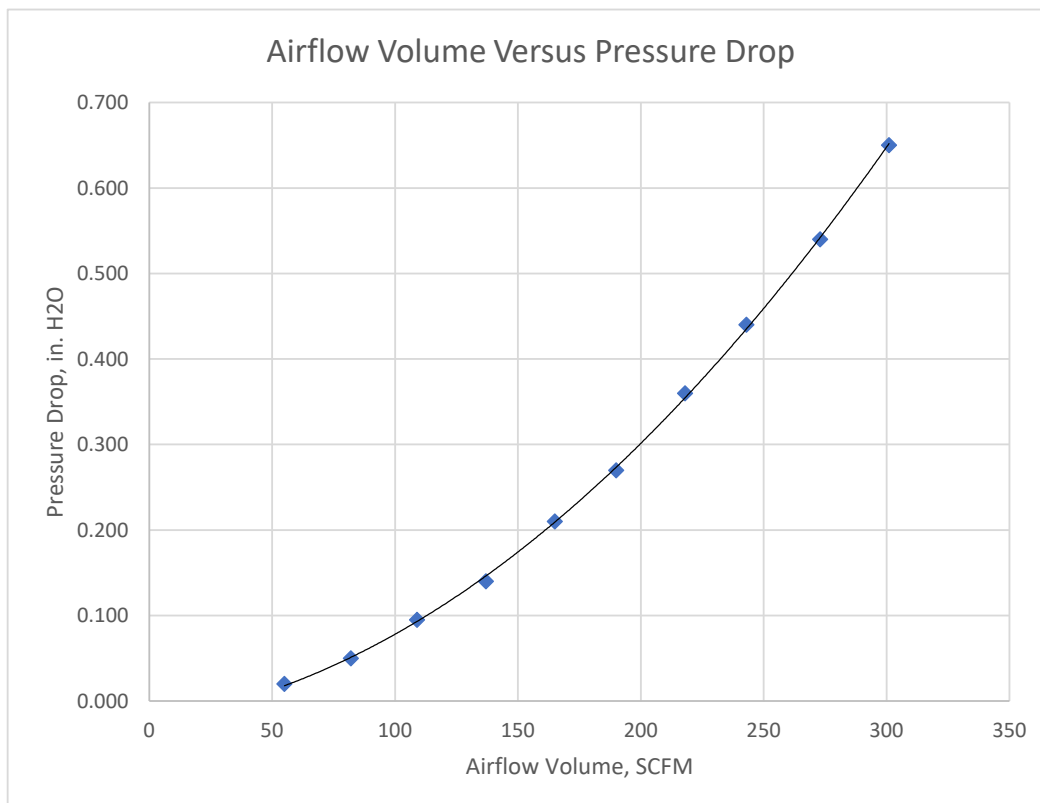

**EQUIPMENT LIST**

**REPORT NO. 105373958CRT-003B**

#	Equipment	Model No	Control No.	Last Cal	Cal Due
5	Manometer Incline	424-5	F166	3/5/2024	3/5/2025
6	Manometer Incline	424-5	F167	3/5/2024	3/5/2025
7	RTD Pair	78N01N00N040B3	T1440/1	6/12/2024	6/12/2025
8	Barometer	PTB110	P1063	6/12/2024	6/12/2025
9					
10					
11					
12					
13					
14					
15					
16					
17					
18					
19					
20					

Remarks:

Test Conditions During Testing:

Drybulb Temperature: 78.5°F

Wetbulb Temperature: 69.9°F

Barometric Pressure: 28.6 in. Hg