# Active Ventilation Products Inc.

# **TEST REPORT**

#### **SCOPE OF WORK**

This report gives the results of air leakage and flow rate testing on a vent. The sample was selected and supplied by the client and was received at the laboratories on:

July 16, 2024

The sample appeared to be in new unused condition upon receipt.

#### **MODEL NUMBER**

RBV-3-C4-TP

Round Back Vent, 3" Diameter, 4" Collar & Tail Pipe Residential Roof Jack Vent Cap for Exhaust Duct Applications

#### **PROJECT NUMBER**

G105373987

### **REPORT NUMBER**

105373987CRT-001b

**ISSUE DATE** 

**REVISED DATE** 

July 29, 2024 10/1/2024

#### **TEST DATE**

July 16 - 24, 2024

#### **DOCUMENT CONTROL NUMBER**

DIFF.PKT.2022 © 2022 INTERTEK





3933 US RT 11 Cortland, NY 13045 Telephone: (607) 753-6711

www.intertek.com

# REPORT NUMBER 105373987CRT-001b

# **MODEL NUMBER(s)**

RBV-3-C4-TP, Round Back Vent, 3" Diameter, 4" Collar & Tail Pipe

#### **REPORT RENDERED TO:**

Active Ventilation Products Inc. 311 1st Newburgh, NY 12550

		ΓΙΟΝ

The testing performed was authorized by signed quote number Qu-01330540-7.

### **TEST STANDARDS**

ANSI/AMCA Standard 500-L-23, entitled "Laboratory Methods of Testing Louvers for Rating".

In Charge of Testing:

Joey Esce Project Engineer Acoustical Testing Reviewer:

Dim Cy

Brian Cyr Engineer Acoustical Testing

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

Page 2 of 5 7/29/2024



3933 US RT 11 Cortland, NY 13045

Telephone: (607) 753-6711 www.intertek.com

# **SAMPLE INFORMATION**

# REPORT NO. 105373987CRT-001B

#### **ITEMS RECEIVED**

Item No.	Control No.	Model No.	Description	Received	
1	CRT2407161020-001	RBV-3-C4-TP	Round Back Vent, 3" Diameter	July 16, 2024	

#### **DESCRIPTION OF TEST SPECIMEN**

The sample consisted of an exhaust vent cap. The inlet measured 2-3/4 inches in diameter and the vent cap measured 5-1/2 inches in diameter. The gap between the cap and collar was measured to be 7/8 inch.

#### **SAMPLE PHOTOS**





#### **TEST METHODS**

Air Performance testing was conducted in accordance with ANSI/AMCA Standard 500-L-23, entitled "Laboratory Methods of Testing Louvers for Rating"

Air Volume was measured employing metering stations containing appropriately sized orifice plates.

Page 3 of 5 7/29/2024



3933 US RT 11 Cortland, NY 13045

Telephone: (607) 753-6711 www.intertek.com

# **RESULTS OF TESTS**

# REPORT NO. 105373987CRT-001B


AIR PERFORMANCE
RBV-3-C4-TP, Round Back Vent, 3" Diameter, 4" Collar & Tailpipe

Pressure Drop Across Vent Cap		Air Velocity	Airflow Volume	
in. H₂O	<u>Pa</u>	<u>fpm</u>	<u>SCFM</u>	
0.060	15	1007	49	
0.080	20	1209	59	
0.100	25	1381	68	
0.135	34	1605	79	
0.170	42	1801	88	
0.200	50	1978	97	
0.240	60	2242	110	
0.280	70	2433	119	
0.310	77	2630	129	
0.350	87	2734	134	

fpm = feet per minute

in. H20 = inches of water

scfm = standard cubic feet per minute

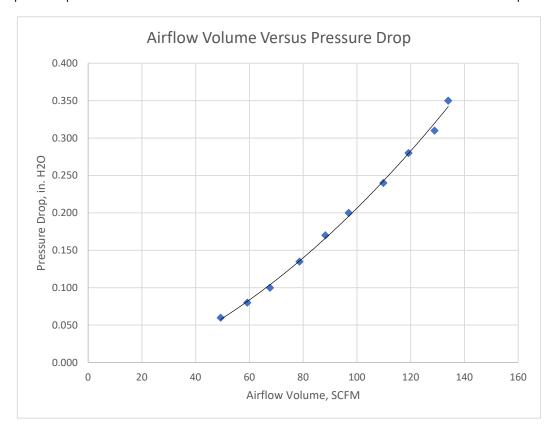

Page 4 of 5 7/29/2024



3933 US RT 11 Cortland, NY 13045

Telephone: (607) 753-6711 www.intertek.com

**EQUIPMENT LIST** 

# REPORT NO. 105373987CRT-001B

#	Equipment	Model No	Control No.	Last Cal	Cal Due
5	Manometer Incline	424-5	F166	3/5/2024	3/5/2025
6	Manometer Incline	424-5	F167	3/5/2024	3/5/2025
7	RTD Pair	78N01N00N040B3	T1440/1	6/12/2024	6/12/2025
8	Barometer	PTB110	P1063	6/12/2024	6/12/2025
9					
10					
11					
12					
13					
14					
15					
16					
17					
18					
19					
20					

Remarks:

Test Conditions During Testing:

Drybulb Temperature: 81.1ºF
Wetbulb Temperature: 72.8ºF
Barometric Pressure: 28.5 in. Hg

Page 5 of 5 7/29/2024